

Approved Roofing over
Approved Roofing Paper

Roof Sheathing

Boundary Nailing
6" o/c w 8d nails

2 x Cont. Blk'g

SCRATCH AND BROWN
COAT ON WIRE LATH
STUCCO FINISH COAT

15 FELT DOUBLE
IF OVER PLYWOOD

2" X STUDS @ 16" OC

**ALL HOLD DOWN BOLTS
MUST BE SET IN PLACE
BEFORE RE QUESTION A
FOOTING INSPECTION**

5/8" X 10 ANCHOR BOLTS
ALL BOLTS MUST BE IN PLACE
FOR FOOTING INSPECTION
W/ 2" X 2" X 3/16" SQUARE WASHERS
6' ON CENTER 12" FROM SPLICES MINIMUM


WEEP SCREED

SLOPE TO DRAIN
2% MIN AWAY FROM BUILDING
5' MIN

(2) #4 RE BAR CONTIN.

**ALL STEEL TO BE 3"
MIN CLEAR FROM EARTH**

12-12-2000
footroof.tnw

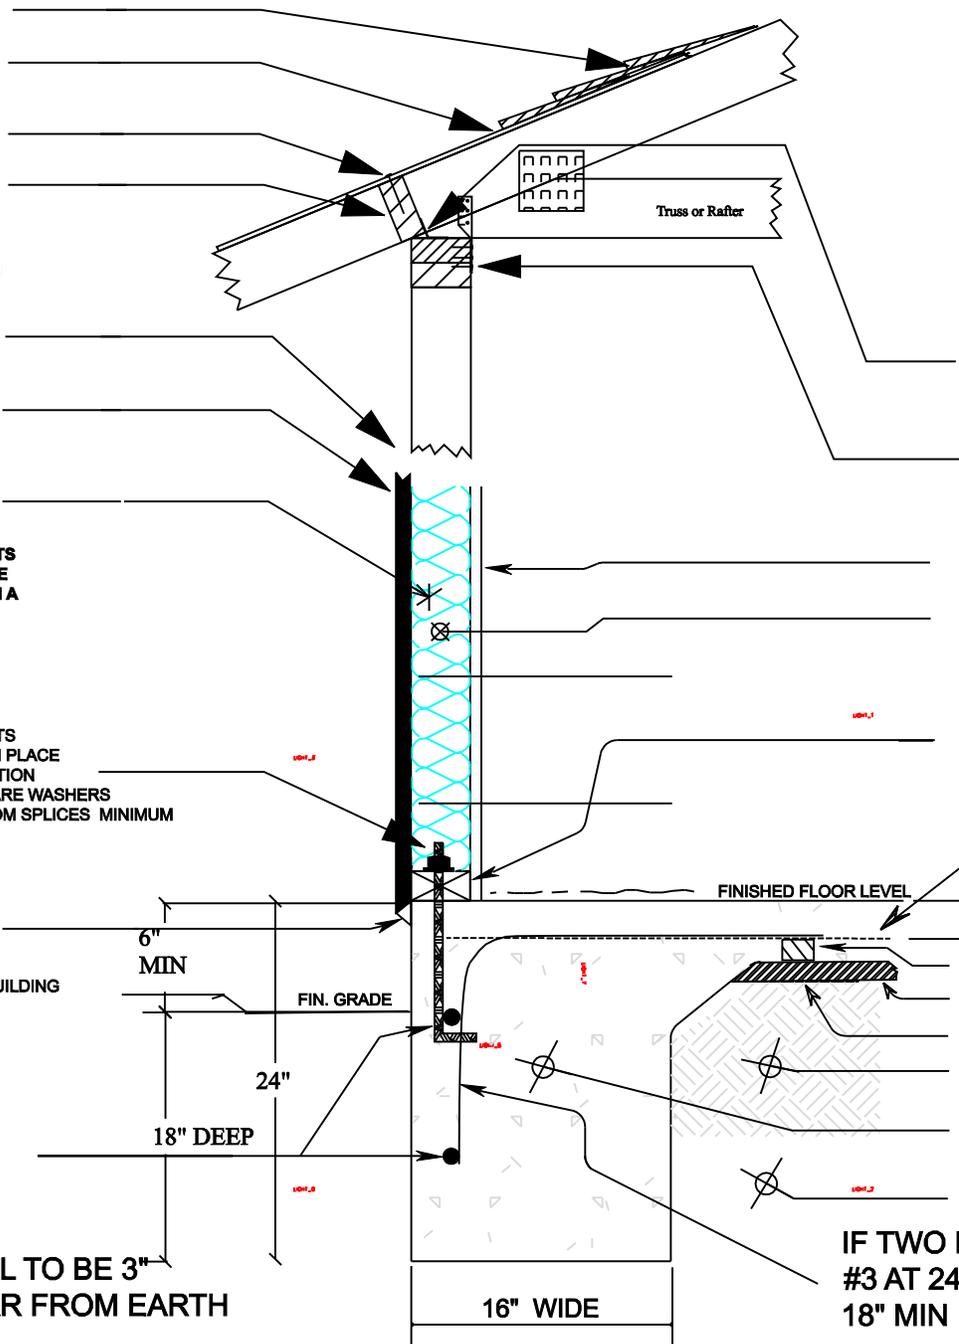

Truss or Rafter

Framing Anchor @
each Block
a35 or equal

Seismic Anchors @
each Truss or Rafter
Hurricane Clips

GYPSUM WALL BOARD

R-13 BATT INSULATION

PRESSURE TREATED BASE PLATE

CONC. SLAB
2500 PSI, 4" MIN.

6-6#10 W.W. MESH
OR #3 @ 24" O/C EACH WAY

STAND OFF

2" OF SAND

6 MIL POLY

COMPACTED FILL

CONCRETE FOOTING
(2500) psi MIN

UNDISTURBED SOIL

**IF TWO PART POUR ADD
#3 AT 24" O/C EACH WAY
18" MIN INTO SLAB**

TYPICAL FOOTING & SLAB AND ROOF CONNECTION DETAIL. SINGLE STORY BUILDING

WITH SIDING OR STUCCO