


FORD ANGLE BALL COPPERSETER
 PADLOCK WING DUAL CARTRIDGE CHECK
 VALVE/INLET P.J./OUTLET DUAL PURPOSE

ARMORCAST METERBOX PER CITY OF LOMPOC
 STANDARD SPECIFICATIONS AND DETAILS
 SECTION II,G,(6)

BROOKS 4-TT
 (TRIANGLE LIDS)

SEE DRAWING 400
 FOR DIMENSIONS

50mm (2") 
 TEE-HEAD
 CORP STOP
 BALL VALVE
 FORD FBI700-7-TA
 OR EQUAL
 MIP x FIP

200mm (8") PVC RISER

NOTCH PIPE RISER TO FIT
 SNUG AROUND SERVICE LINE

PVC PACK JOINT
 COUPLING ADAPTER


50mm (2") PVC SCHEDULE 80 OR BRASS
 PER SECTION II MATERIALS, G(1) OF THE
 LOMPOC STANDARD SPECIFICATIONS & DETAILS

FORD DOUBLE
 BAND SADDLE
 #202BS OR EQUAL

CONCRETE SLAB

INSTALL 1/4" MESH - 14 GAUGE
 GALVANIZED SCREEN AS
 GOPHER BARRIER PROTECTION

25mm (1") TYPE K COPPER
 SHOWN WITH 6 MIL PLASTIC
 SLEEVE TAPE


 WATER METER BOXES SHALL SIT 100mm (4")
 BEHIND SIDEWALK OR CURB, BUT SHALL NOT
 BE PLACED IN SIDEWALKS OR DRIVEWAYS

LOCATION OF VALVE ON EXISTING SERVICE LINES WITH CORP STOP

ALL BRASS SWING JOINT



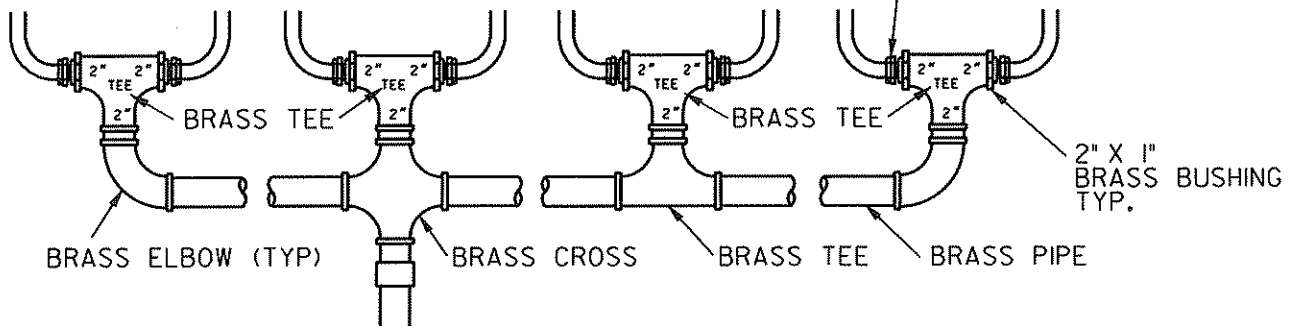

LOCATION OF VALVE ON NEW SERVICE LINES

25mm (1") MIPT X 25mm
 (1") PACK JOINT FOR
 C.T.S., C84-44 FORD
 OR EQUAL (TYP.)



Drawing No. 406

CITY OF LOMPOC
 Utility Department, Water Division

MARK	REVISIONS	APPR.	DATE
	Modified Manufacturer Ref.	KM	11/05
	Removed 3/8" meter from title.	KM	9/07
	Changed part number associated with manifold.	KM	11/07
	Title Remove references to 3/8" service line. Manifold now 2 to 8 not 4 to 8.	KM	2/02

1", 2 - 8 METER MANIFOLD

